

SECTION 00490

ADDENDUM NO. 3

**RAW WATER SUPPLY IMPROVEMENTS
BRUNSWICK REGIONAL WATER AND SEWER H2GO
LELAND, NORTH CAROLINA**

SUBJECT: ADDENDUM NO. 3

SEPTEMBER 12, 2024

To the Plans and Specifications for:
Raw Water Supply Improvements
Leland, N.C.

To: PROSPECTIVE BIDDERS AND OTHER CONCERNED PARTIES

This ADDENDUM forms a part of the Contract Documents and modifies the original Bidding Documents as noted below. Bidders shall acknowledge receipt of the ADDENDUM in the space provided on the Bid Form. Failure to do so may subject the Bidder to Disqualification.

A. General

1. The Bid Date has been extended one week. Bids will be received until **2:00 pm, Tuesday, September 24, 2024** in the Conference Room of the Brunswick Regional Water and Sewer H2GO Water Treatment Plant located at 146 Gregory Road NE, Belville, N.C.

B. Bidding Requirements (Previous Addendum No. 2)


1. Document 00410, Bid Form – Attachment to Addendum No. 2
 - a. Bid Items 47 and 47a: **Change** the beginning Station from Station 37+75 to **Station 38+07**. This is consistent with Drawing C-1.04.

C. Technical Specification Requirements

1. Section 01270, Unit Prices
 - a. Paragraph 1.35.B – **Add** the following: Existing wire size for Well 01P is 1/0.
 - b. Paragraph 1.36.B – **Add** the following: Existing wire size for Well 02P is 4/0.
 - c. Paragraph 1.37.B – **Add** the following: Existing wire size for Well 03P is 2/0.
 - d. Paragraph 1.38.B – **Add** the following: Existing wire size for Well 04P is 250 kcmil.
 - e. Paragraph 1.39.B – **Add** the following: Existing wire size for Well 05P is 4/0.
2. Section 11068, Submersible Well Pump
 - a. Paragraph 2.01.C: **Change** to read as follows: Discharge Column: The discharge column shall be 6.625" O.D., ASTM A778, 316L Stainless Steel column pipe rated for the applicable load at the pump setting depth as indicated. Column pipe casing shall be manufactured in accordance with applicable parts of ASTM A778 for spirally welded steel casing. Welding shall be by the submerged-arc process using at least one pass on the inside and one pass on the outside. Column pipe shall be a minimum 0.28" wall thickness made from 316L Stainless Steel in lengths varying from 1' to 20'. Column pipe shall have 6" NPS double O-ring seal, double spline, 316L spline lock connectors. All stainless steel material shall meet NSF 61 compliance.

Bids will be received until 2:00 pm, September 24, 2024.

FOR THE OWNER
THE WOOTEN COMPANY

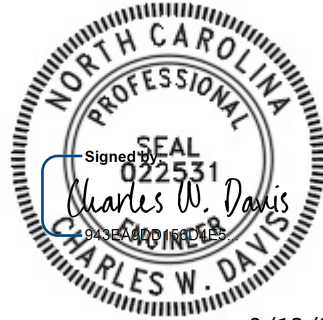

BY _____ 9/12/2024
Charles W. Davis, P.E.

END OF DOCUMENT